



## CONNECT DISPENSER POWER CORD


INLET WATER SUPPLY  
CONNECT 1/2" BSP BRAIDED HOSE  
ATTACH TO 1/2" BSP STOP TAP

CHILLED WATER OUTLET  
CONNECT TO BLUE TUBE ON DISPENSER



HOT VENT  
CONNECT TO GREY TUBE ON DISPENSER

POWER CORD  
CONNECT TO POWER SUPPLY

BOILING WATER OUTLET  
CONNECT TO RED TUBE ON DISPENSER

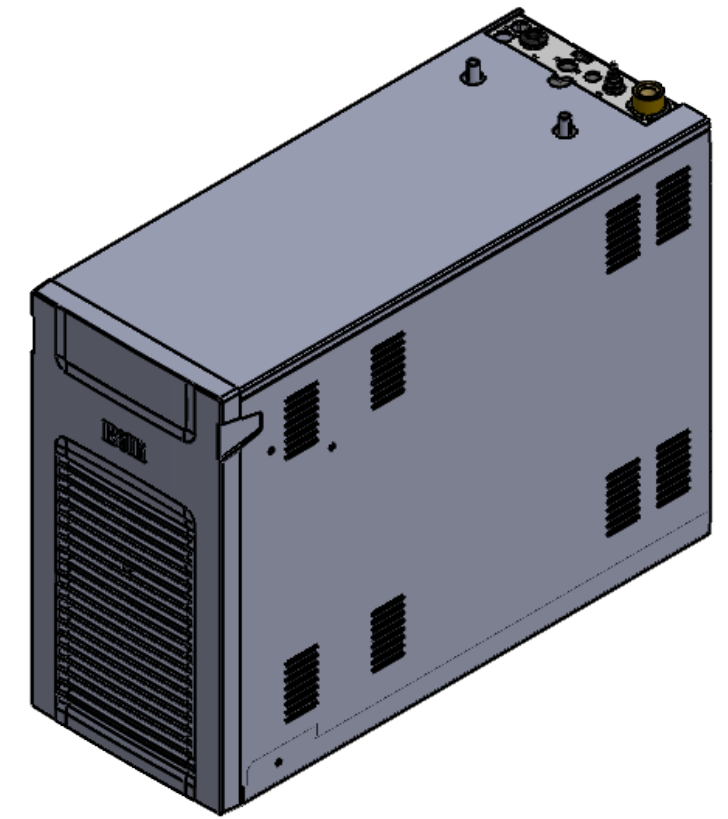

POWER SUPPLY REQUIREMENTS:  
320/360 & 320 PLUS/360 PLUS MODELS REQUIRE 10 AMP SOCKET  
3120 & 3120 PLUS MODELS REQUIRE A 15 AMP SOCKET

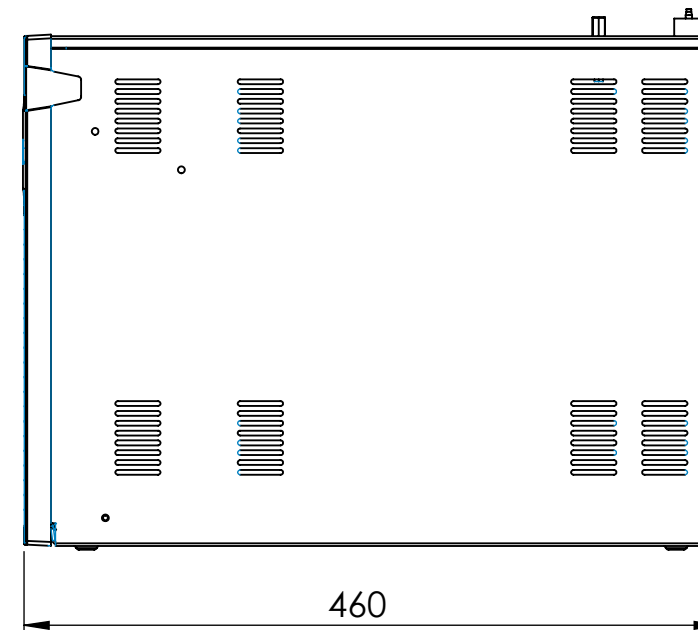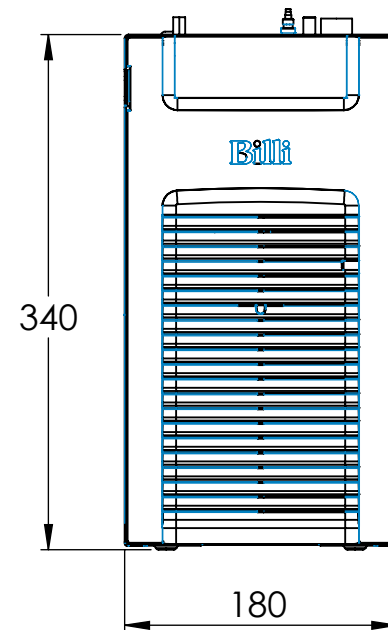


- NOTES:
1. INLET WATER SUPPLY PRESSURE TO BE BETWEEN 250-1000Kpa.
  2. DO NOT INSTALL WITH WATER SUPPLY THAT IS MICROBIOLOGICALLY UNSAFE OR OF UNKNOWN WATER QUALITY WITHOUT ADEQUATE DISINFECTION BEFORE THE SYSTEM.
  3. UNIT MUST BE INSTALLED WITH A MINIMUM SPACE OF 10mm AROUND BOTH SIDES OF THE UNIT.
  4. A 1/2" BSP STOP TAP MUST BE INSTALLED WITHIN 450mm OF UNIT.
  5. UNIT MUST BE INSTALLED IN THE ORIENTATION SHOWN WITH CONNECTIONS FACING UP.



TITLE

SAHARA & SAHARA PLUS

UNLESS OTHERWISE SPECIFIED:



THRID ANGLE

DEMINSIONS ARE IN mm

DWG NO.		REV. <b>01A</b>
SHEET SIZE <b>A3</b>	SHEET SCALE <b>1:5</b>	